



NOTES:


- 1.) TRANSVERSE EXPANSION JOINTS TO BE A MAXIMUM OF 50 FEET.
- 2.) ALL CONCRETE TO BE FINISHED WITH CURING COMPOUND.
- 3.) THE CONSTRUCTION OF A SIDEWALK MAY UTILIZE ASPHALT (TYPE I-1 OR I-2) MATERIAL UPON PRIOR APPROVAL BY THE CITY ENGINEER. IN SUCH CASES THE CONSTRUCTION SHALL CONSIST OF FOUR (4) INCHES CABC AND TWO (2) INCHES OF TYPE I-1 OR I-2.

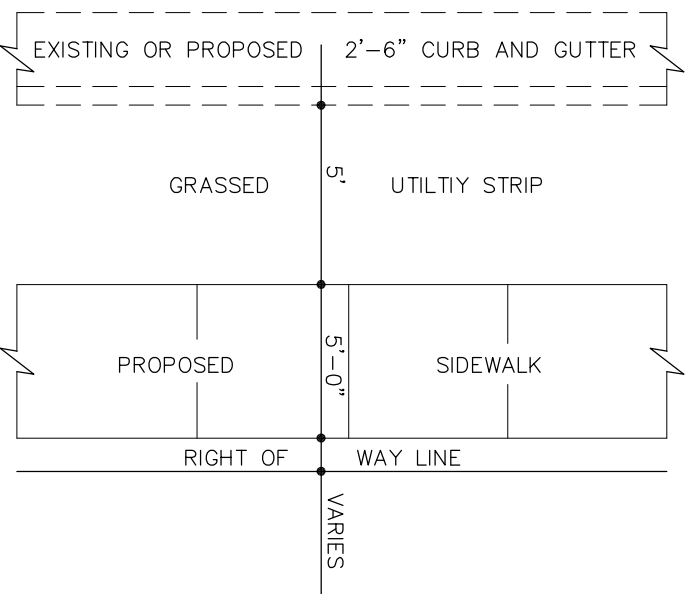

PLAN VIEW

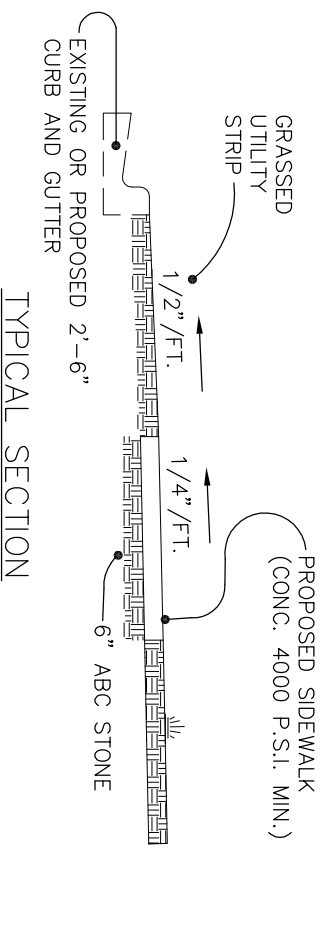

TYPICAL SECTION

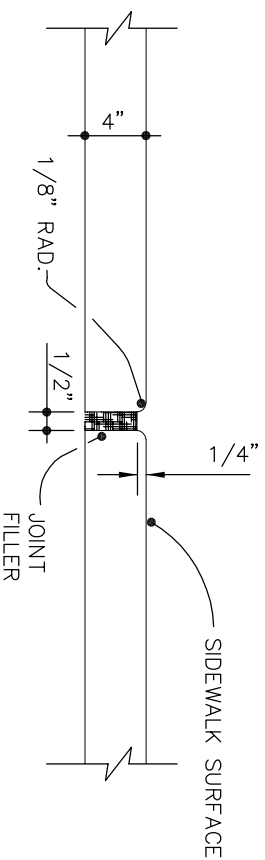

TRANSVERSE EXPANSION JOINT

REVISIONS

DATE	DESCRIPTION



ASHEVILLE

CITY OF ASHEVILLE, N.C.
ENGINEERING DEPARTMENT

STANDARD CONCRETE SIDEWALK

STD. No.

3.16